Request for Sealed Quotations for Goods

Supply and Delivery of Hot-Dipped Galvanised Steel Pipe Fittings, Flange Adaptors and Gate Valves for the Oshakati Temporary Evaporation Ponds.

Procurement Reference No: G/RFQ/NW-039/2027

Name of Bidder		
Contact Person		
E-mail Address		
Postal Address		
Total Amount (Excl. VAT)		
Contact Phone number	**Work:**	**Mobile:**

Documents must be posted / delivered to:

The Quotation/Bid Box

Att: Procurement Management Unit (PMU) (bids@namwater.com.na)

Namibia Water Corporation Ltd.

Private Bag 13389

176 Iscor Street, Aigams Building

Windhoek

Closing Date: Thursday, 19 November 2026 at 11h00
NO LATE BIDS WILL BE ACCEPTED!

NOTICE TO BIDDERS

- **Please take note of initializing all pages of the standard bidding document and initial all the supporting documents including company profiles, brochures, etc.**
- **Take note to sign all relevant pages as stipulated in the bidding standard document.**
- **Copies of documents not certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963) will not be accepted.**

Namibia Water Corporation Ltd.
Private Bag 13389, Windhoek, Namibia
Tel: +264 61 71 2066
Fax: +264 61 21 0741

Letter of Invitation

Name and Address of Bidder_____

Procurement Reference Number: G/RFQ/NW-039/2027

09 November 2026

Dear Bidders,

Request for Quotations for Supply and Delivery of Hot-Dipped Galvanised Steel Pipe Fittings, Flange Adaptors and Gate Valves for the Oshakati Temporary Evaporation Ponds.

NamWater invites you to submit your best quote for the items described in detail hereunder.

Any resulting contract shall be subject to the terms and conditions referred to in the document.

Queries, if any, should be addressed to the Procurement Management Unit, e-mail: bids@namwater.com.na , Private Bag 13389, Windhoek, Namibia.

Please prepare and submit your quotation in accordance with the instructions given or inform the undersigned if you will not be submitting a quotation.

Yours faithfully,

Procurement Management Unit

SECTION I: INSTRUCTIONS TO BIDDERS

1. Rights of Public Entity

NamWater reserves the right:

(a) to split the contract as per the lowest evaluated cost per item, or

(b) to accept or reject any quotation; and

(c) to cancel the quotation process and reject all quotations at any time prior to contract award.

2. Preparation of Quotations

You are requested to quote for the items mentioned in Section III by completing, signing and returning:

(a) the Quotation Letter in Section II with its annex for Bid Securing Declaration

(b) the List of Goods and Price Schedule Section III;

(c) the Specifications and Compliance Sheet in Section V; and

(d) any other attachment deemed appropriate.

You are advised to carefully read the complete Request for Sealed Quotations document, including the Special Conditions of Contract in Section VII, before preparing your quotation. The standard forms in this document may be retyped for completion but the Bidder is responsible for their accurate reproduction.

3. Validity of Quotations

The Quotation validity period shall be **120** days from the date of submission deadline.

4. Eligibility Criteria

To be eligible to participate in this Quotation exercise, you should:

(a) Have a certified copy (certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)), of a full valid company Registration Document;

(b) Have an original or a certified copy (certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)), of a valid Good Standing Tax Certificate, as certified by the Commissioner of Oath;

(c) Have an original valid good Standing Social Security Certificate;

(d) Have a valid certified copy (certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)), of Affirmative Action Compliance Certificate, proof from Employment Equity Commissioner that bidder is not a relevant employer, or exemption issued in terms of Section 42 of the Affirmative Action Act, 1998 or a valid certified copy of the original document, as certified by the Commissioner of Oath;

(e) Submit signed Bid-securing Declaration.

(f) An undertaking on the part of the Bidder that the salaries and wages payable to its personnel in respect of this proposal are compliant to the relevant laws, Remuneration Order, and Award, where applicable and that it will abide to sub-clause 4.6 of the General conditions of Contract if it is awarded the contract or part thereof; and;

(g) Submit a minimum of one (1) reference letter from reputable entities whom the Bidder has supplied similar materials **(Steel Pipe Fittings, Flange Adaptors and Gate Valves)** in the last three (3) years and handled successfully.

(h) Supporting information/literature for all the items offered to substantiate compliance, where applicable. These documents must be from the manufacturer or an authorised manufacturer's representative. Representatives must provide an authorised letter from the manufacturer confirming their status.

(i) A Bidder that is under a declaration of ineligibility by the Government of Namibia in accordance with applicable laws at the date of the deadline for bid submission or thereafter, shall be disqualified.

Bids from service providers appearing on the ineligibility lists of African Development Bank, Asian Development Bank, European Bank for Reconstruction and Development, Inter-American Development Bank Group and World Bank Group shall be rejected.

Links for checking the ineligibility lists are available at:

- Republic of Namibia, Procurement Policy Unit

  https://egp2.gov.na/forms/SearchSuspendedBidders.jsf

- African Development Bank

  https://www.afdb.org/en/projects-operations/debarment-and-sanctions-procedures

- Asian Development Bank

  http://lnadbg4.adb.org/oga0009p.nsf/sancALLPublic?OpenView&count=999

- European Bank for Reconstruction and Development

  http://www.ebrd.com/pages/about/integrity/list.shtml

- Inter-American Development Bank Group

  http://www.iadb.org/en/topics/transparency/integrity-at-the-idb-group/sanctioned-firms-and-individuals,1293.html

- World Bank Group
  http://www.worldbank.org/en/projects-operations/procurement/debarred-firms

5. Bid Securing Declaration

Bidders are required to subscribe to a Bid Securing Declaration for this procurement process.

6. Delivery

Delivery shall be **60 days** after acceptance/issue of Purchase Order. Deviation in delivery period shall be considered if such deviation is reasonable.

7. Sealing and Marking of Quotations

Quotations should be sealed in a single envelope, clearly marked with the Procurement Reference Number, addressed to the Public Entity with the Bidder's name and contact information at the back of the envelope.

8. Submission of Quotations

Quotations should be deposited in the Quotation/Bid Box located at Namibia Water Corporation Ltd Head office, Private Bag 13389, 176 Iscor Street, Aigams Building, Windhoek, not later than **Thursday, 19 November 2026 at 11h00**. Offers by post or hand delivered should reach Private Bag 13389 by the same date and time at latest. Late Offers will be rejected.

Quotations received by e-mail will not be considered.

9. Opening of Quotations

Quotations will be opened internally by the Public Entity immediately after the closing time referred to in instruction 8 above. A record of the Quotation Opening stating the name of the bidders, the amount quoted, the presence or absence of a Bid Securing Declaration, will be posted on the website of the Public Entity and available to any bidder on request within three working days of the Opening.

10. Evaluation of Quotations

The Public Entity shall have the right to request for clarifications in writing during evaluation. Offers that are substantially responsive shall be compared on the basis of price or ownership cost, subject to Margin of Preference where applicable, to determine the lowest evaluated quotation.

11. Technical Compliance

Bidders shall submit along with their quotations documents, catalogues and any other literature to substantiate compliance with the required specifications and to qualify deviations if any with respect to Public Entity's requirements.

The Specifications, Performance Requirements and Compliance Sheet detail the minimum specifications of the goods/items to be supplied. The specifications have to be met but no credit will be given for exceeding the specifications.

12. Prices and Currency of Payment

Prices shall be fixed in Namibian Dollars.

13. Margin of Preference

Not applicable

14. Award of Contract

The Bidder having submitted the lowest evaluated responsive quotation and qualified to supply the goods/items and related services shall be selected for award of contract. Award of contract shall be by issue of a Purchase Order/Letter of Acceptance in accordance with terms and conditions contained in Section VI: Contract Agreement and General Conditions of Contract.

15. Notification of Award and Debriefing

The Public Entity shall after award of contract promptly inform all unsuccessful bidders in writing of the name and address of the successful bidder and the contract amount and post a notice of award on its website within seven (7) days. Furthermore, the Public Entity shall attend to all requests for debriefing made in writing within seven (7) days of the unsuccessful bidders being informed of the award.

SECTION II: QUOTATION LETTER

(to be completed by Bidders)

Complete this form with all the requested details and submit it as the first page of your quotation with the Price list and documents requested above. A signature and authorisation on this form will confirm that the terms and conditions of the RFQ prevail over any attachments. **If your quotation is not authorised, it will be rejected**.

Quotation addressed to*:*	**Namibia Water Corporation Ltd (NamWater)**
Procurement Reference Number:	**G/RFQ/NW-039/2027**
Subject matter of Procurement:	**Supply and Delivery of Hot-Dipped Galvanised Steel Pipe Fittings, Flange Adaptors and Gate Valves for the Oshakati Temporary Evaporation Ponds.**

We offer to supply the items listed in the attached List of Goods and Price Schedule as per the defined specifications, *except for the qualified deviations [Bidder may delete this phrase in case of no deviation]* and, in accordance with the terms and conditions stated in your Request for Quotations referenced above.

We confirm that we are eligible to participate in this Quotation exercise and meet the eligibility criteria specified in Section 1: Instruction to Bidders.

We undertake to abide ethical conduct during the procurement process and the execution of any resulting contract.

We have read and understood the content of the Bid Securing Declaration (BSD) attached hereto and subscribe fully to the terms and conditions contained therein. We further understand that this subscription could lead to disqualification on the grounds mentioned in the BSD].

The validity period of the Quotation is _____ days *[insert number of days]* from the date of the bid submission deadline.

We confirm that the prices quoted in the List of Goods and Price Schedule are fixed and firm and will not be subject to revision or variation, if we are awarded the contract **prior to the expiry** date of the quotation validity.

The delivery period offered from the date of issue of Purchaser Order/ Letter of Acceptance is as shown in the List of Goods items and Price Schedule.

Quotation Authorised by:

Name of Bidder		Company's Address and seal	
Contact Person			
Name of Person Authorising the Quotation:		Position:	Signature:
Date		Phone No./Fax	

Appendix to Quotation Letter

BID SECURING DECLARATION
(Section 45 of Act)
(Regulation 37(1)(b) and 37(5))

Date: .....

Procurement Ref No.: .....

To: Namibia Water Corporation Ltd, Private Bag 13389, 176 Iscor Street, Aigams Building, Windhoek

I/We* understand that in terms of section 45 of the Act a public entity must include in the bidding document the requirement for a declaration as an alternative form of bid security.

I/We* accept that under section 45 of the Act, I/we* may be suspended or disqualified in the event of

(a) a modification or withdrawal of a bid after the deadline for submission of bids during the period of validity;

(b) refusal by a bidder to accept a correction of an error appearing on the face of a bid;

(c) failure to sign a procurement contract in accordance with the terms and conditions set forth in the bidding document, should I/We* be successful bidder; or

(d) failure to provide security for the performance of the procurement contract if required to do so by the bidding document.

I/We* understand this bid securing declaration ceases to be valid if I am/We are* not the successful Bidder

Signed: .....
[*insert signature of person whose name and capacity are shown*]

Capacity of:
[indicate legal capacity of person(s) signing the Bid Securing Declaration]

Name: .....
[insert complete name of person signing the Bid Securing Declaration]

Duly authorized to sign the bid for and on behalf of: [insert complete name of Bidder]

Dated on _____ day of _____, _____
[*insert date of signing]*

Corporate Seal (where appropriate)

[Note*: In case of a joint venture, the bid securing declaration must be in the name of all partners to the joint venture that submits the bid.]
delete if not applicable / appropriate

Republic Of Namibia

Ministry of Labour, Industrial Relations and Employment Creation

Witten undertaking in terms of section 138 of the Labour Act, 2015 and section 50(2)(D) of the Public Procurement Act, 2015

1. EMPLOYERS DETAILS

Company Trade Name:……

Registration Number :...……...

Vat Number: ……

Industry/Sector: ……

Place of Business:……..

Physical Address:……..

Tell No.:……

Fax No.:…….

Email Address:……..

Postal Address:……..

Full name of Owner/Accounting Officer:……..……...

…….....

Email Address:……..

2. PROCUREMENT DETAILS

Procurement Reference No.:…….

Procurement Description: …….

……

……

Anticipated Contract Duration: …….

Location where work will be done, good/services will be delivered: …….

……

3. UNDERTAKING

I …… *[insert full name],* owner/representative

of ……*[insert full name of company]*

hereby undertake in writing that my company will at all relevant times comply fully with the relevant provisions of the Labour Act and the Terms and Conditions of Collective Agreements as applicable.

I am fully aware that failure to abide to such shall lead to the action as stipulated in section 138 of the labour Act, 2007, which include but not limited to the cancellation of the contract/licence/grant/permit or concession.

Signature: ……..

Date: ……..

Seal:…….

Please take note:

1. *A labour inspector may conduct unannounced inspections to assess the level of compliance*
2. *This undertaking must be displayed at the workplace where it will be readily accessible and visible by the employees rendering service(s) in relations to the goods and services being procured under this contract.*

SECTION III: PRICED ACTIVITY SCHEDULE

QUOTATION FOR: Supply and Delivery of Hot-Dipped Galvanised Steel Pipe Fittings, Flange Adaptors and Gate Valves for the Oshakati Temporary Evaporation Ponds.

Procurement Reference Number: **G/RFQ/NW-039/2027**

INSTRUCTIONS TO THE PUBLIC ENTITY				INSTRUCTIONS TO BIDDERS					
At time of preparation of the RFQ, Columns A to D shall be filled in by the Public Entity. [*To be filled by the Public Entity*]				Bidders shall fill-in columns E - I and fill the total E= mark with a *if an equivalent is quoted F= Rate per unit G=Total price for one item (C x F) • If an equivalent is quoted, please attach to your quote appropriate technical information & specification • Bidders shall fill in and sign the bottom section of this page					
A	B	C	D	E	F	G	H	I	
Item no.	Description of Goods	Quantity	Unit of measure	*	Price per unit NAD[1]	Total price without VAT NAD	VAT: NAD	Delivery (weeks/days /months)	Country of Origin
	Valves								
1.	700NB PN10 SABS 664 Resilient Seat Gate Valve. Flanged and drilled to SABS 1123, Table 1000/3.	1	No.						
2.	600NB PN10 SABS 664 Resilient Seat Gate Valve. Flanged and drilled to SABS 1123, Table 1000/3.	1	No.						
	Steel Fabricated Fittings								
3.	700 x 600NB HDG Reducing Steel T-Piece as per attached drawing. Flanged both ends. Flanges drilled to SABS 1123, Table 1000/3.	1	No.						
	Flange Adaptors								
4.	700NB PN10 Dedicated Flange Adaptor drilled to SABS 1123, Table 1000/3.	2	No.						
5.	600NB PN10 Dedicated Flange Adaptor drilled to SABS 1123, Table 1000/3.	3	No.						
	Miscellaneous Items								
6.	M24 HDG Bolts x 150mm Long	80	No.						

7.	M24 HDG Bolts x 130mm Long	60	No.						
7.	M24 HDG Nuts	140	No.						
8.	M24 HDG Washers	140	No.						
9.	Gasket to fit 600NB PN10 Flange	6	No.						
10.	Gasket to fit 700NB PN10 Flange	6	No.						
					TOTAL				

Priced Activity Schedule Authorised By:

Name:		Signature:	
Position:		Date:	
Authorised for and on behalf of:		Company	

1. If Price quoted is subject to change in rate of exchange at the time of delivery of goods provide details hereunder:

   Currency : …….. Exchange Rate: …….

If no base rate of exchange is given, the price shall be treated as firm in Namibian Dollars for all intent and purpose.

Key notes: **NA**=NOT APPLICABLE, **NQ**=NO QUOTE

SECTION IV: SPECIFICATIONS AND PERFORMANCE REQUIREMENTS

3.1 General

The supplier shall refer to the following attached detail drawing for the items as tabulated in Section III:

- Dwg 15/4/1/7/6 – 354R0 - Oshakati Temporary Evaporation Ponds: 700NB X 600NB Pipe Fitting Detail

All flanges of fabricated pipe specials shall conform to SANS 1123 unless otherwise denoted.

All flanges of pipe specials shall be fitted in the two-hole-top off the centreline configuration.

3.2 Pipework

Steel pipes shall comply with SANS 62 or SANS 719 Grade B/C.

The wall thickness of fittings (Tees and bends) shall be according to the ANSI (ASA) B16.9 fittings standard wall thickness schedule or thicker.

Unless otherwise stated, all manufactured pipe specials shall comply with the following specifications:

Nominal Diameter	Outside Diameter	Minimum Wall Thickness
600NB	609.6 mm (as per SANS 719)	4.5 mm
700NB	711.2 mm (as per SANS 719)	4.5 mm

All pipework welding shall be done as per SANS 10044 for steel fusion welding. Mating surfaces shall be welded all around their mating periphery.

3.3 Pipework Couplings

Flexible flange adaptor couplings will be supplied and delivered to join plain-ended pipes to flanged valves, fittings and pipes.

Only Klamflex dedicated flexible pipe couplings or similar shall be acceptable:

All flanges of flexible pipe couplings shall conform **to SANS 1123** the pressure rating of the pipe couplings shall be indicated in the list of goods and price schedule.

The couplings shall allow for angular misalignment (± 6°) and axial adjustment.

All coupling welding shall be done **per SANS 10044** for steel fusion welding.

All flange adaptors shall be complete and ready for installation with the necessary sleeves, rubber wedge rings and clamping bolts and nuts.

All dedicated flange adaptors shall be suitable for installation with restraining rods. Should dedicated flange adapters have a raised edge that contacts the gasket with installation, not less than 90% of the appropriate gasket area shall be in contact with the flange adapter. Flush faced flange adapters will be preferred.

3.4 Flanged Gate Valve Design

3.4.1 Operating Requirements and Standards

The required gate valve is of double flanged resilient seated gate valve type. The gate valve will be installed as isolation valves for potable water applications.

The flange drilling shall be to SANS 1123 and the pressure rating shall be as indicated in the price schedule.

3.4.2 Materials of Construction

EPDM sealing rings (on the bonnet) shall be replaceable without dismantling the valve.

The leading edges of the sealing rings shall be slightly chamfered.

Valves with adjustable seats/seals will not be accepted. The valves shall be tight in both directions.

Measures to prevent over travel of the disk when closed shall be in place.

Flanges shall be used in the two-hole-top configuration

The valves shall be supplied with hand wheels.

Materials of Construction for all Gate Valves

Component	Material Type	Material Specifications
Body	SG Iron / Ductile Cast Iron	BS 2789 Gr 420/12, SABS 936 SG 42 / EN-JS 1030 (GGG-40)
Bonnet	SG Iron / Ductile Cast Iron	BS 2789 Gr 420/12, SABS 936 SG 42 / EN-JS 1030 (GGG-40)
Disk (Wedge)	SG Iron/ Ductile Cast Iron/ Stainless steel Epoxy Coating / Rubber lined	BS 2789 Gr 420/12, SABS 936 SG 42 / EN-JS 1030 (GGG-40)
Shaft (Stem)	Stainless Steel / Zinc free Bronze	SS Grade 431/420
Bushing / Bearings	Zinc-Free Bronze	BS 1400 LG2
External Fasteners and Internal Fasteners	Stainless Steel	Grade 316/431
Seals	EPDM / Nitrile / Viton	EPDM / Nitrile / Viton
Packing	Graphite Fiber	**Note**: No Asbestos
Internal & External Coating	Epoxy according to GSK guidelines	The total DFT shall be not less than 250µm

3.4.3 Operating Requirements

The valve shall be capable of withstanding a maximum operating pressure of as indicated in the price schedule at 40°C under all operating conditions.

The wedge shall operate satisfactorily under the specified conditions.

The valves shall be able to open and close satisfactorily under a flow velocity of 3 m/s.

The bolts to be of grade 8.8 unless stated otherwise. All fasteners where applicable shall be SABS 136-1972. All bolts, nuts, threaded rods and washers, excluding stainless steel fasteners, shall be hot dip galvanized as per SABS ISO 1461: 1999. **Electroplated bolts, nuts and washers shall not be accepted.**

3.5 Fasteners

The bolts to be of **grade 4.8** unless stated otherwise. All fasteners where applicable, shall be ISO metric according to SANS 1700. All bolts (full thread), nuts, threaded rods and washers shall be hot dip galvanized as per SANS ISO 1461: 1999. **Electroplated bolts, nuts and washers shall not be accepted.**

3.6 Gaskets

The gasket OD should be dictated by the flange specifications. The gaskets shall be of non-asbestos compressed fibre or graphite type. The gaskets shall be suitable for potable and raw water at temperatures from 0°C to 60°C. The gaskets shall have a thickness of 3mm.

Full faced gaskets will not be accepted.

3.7 Corrosion Protection

All steel surfaces shall be blast clean to SANS 10064 and the final finishing shall comply with S.I.S. 05 5900 grade Sa 2.5. before galvanizing or primer.

Unless otherwise stated, all pipe specials, flanges and flexible pipe coupling items shall be hot-dip galvanized to SANS ISO 1461:1999.

Note: The average galvanizing layer thickness shall not be less than 150 microns and the minimum thickness at any spot, not less than 100 microns.

3.8 Inspections

NamWater will inspect all items upon delivery to ascertain if dimensions, pressure flange rating and coating are correct. NamWater will not send a technical person to go inspect the items at the factory, the onus thus rest with the supplier to ensure that all items are to specifications before delivery is made to NamWater.

Payment will only be made if all the delivered items are to specifications.

3.9 Labelling

The supplier may use the item numbers already allocated or an appropriate method consistent with the order of the item's numbers in this document.

3.10 After Sales Services

An authorised sales agent capable of replacing the offered items during the guarantee period must be in Namibia. The sales agent must be able to replace failed offered items to NamWater Head office within 30 working days of receipt of request for such items.

3.11 Supporting Data

A bidder will be disqualified if the following information is not included with the offer:

- Technical Supporting information for Pipe Couplings/Flange Adaptors
- Technical Supporting information for Gate Valves

SECTION V: SPECIFICATIONS AND COMPLIANCE SHEET

Procurement Reference Number: _____

[Bidders should complete columns C and D with the specification of the goods offered by stating "comply" or "not comply" and give details of any non-compliance/deviation to the specification required. Attach detailed technical literature if required. Authorise the specification offered in the signature block below.]

Item No	Technical Specification Required	Compliance of Specification Offered	Details of Non-Compliance/ Deviation (if applicable)
A*	***B****	***C***	***D***
1	**General Information**		
	All flanges, where applicable, conform to SANS 1123/1000/3		
	Suitable for drinking water?		
	Pipe wall thickness as specified		
	Klamflex dedicated flange adapters or similar, suitable for mild steel pipe according to SANS 719 outside diameters		
	Corrosion protection as specified		
	All steel surfaces shall be blasted clean to SABS 064 and the final finish shall comply with ISO 8501-1 grade Sa 2.5 before Coating		
	Hot-dipped galvanized as per SANS 121: 2000		
	All steel welding shall be done in accordance SANS 10044 for Steel fusion welding		
	Welding done along all contact seams.		
	Suitable for potable and raw water at temperatures from 0°C to 60°C		
	3mm thickness Gaskets		
	Ring gasket (not full-face)		
	All fasteners where applicable, shall be ISO metric according to SANS 1700		

	All fasteners hot dip galvanized as per SANS 121: 2000		

Item No	Technical Specification Required	Compliance of Specification Offered	Details of Non-Compliance/ Deviation (if applicable)
*A**	*B**	*C*	*D*
2	**Pipework**		
	Average galvanizing layer thickness of 150 microns and the minimum thickness at any spot not less than 100microns.		
	All SANS 1123/1000/3 flanged pipes conform to SABS 62 or SABS 719		
3	**Hot Dipped Galvanised Pipe Couplings**		
	Suitable for installation with restraining threaded bars?		
	Body and end rings are made of ductile iron or steel		
	Coating is hot dip galvanized to SABS ISO 1461:1999		
4	**Flanged Gate Valve**		
	The valves shall be NFS or DVGW or WRAS or ACS or KIWA or WaterMark™ Schedule - Level 1 or SVGW certified / approved for drinking water.		
	Valves shall be internally and externally coated according to EN 14901 or GSK or AS/ZNS 4158 regulations / guidelines.		
	The valves shall be pressure tested in accordance with EN 12266 or ISO 5208		
	PN10 valves shall fit between flanges drilled to SANS1123/1000/3 respectively. The flanges shall be fitted in the two-hole-top orientation.		
	The valves shall be resilient seated in accordance with EN 1074.		
	The valves shall have face-to-face dimensions according to EN 558-1, basic series 15.		

	Valve bodies and bonnets shall be ductile cast iron.		
	Valve gates shall be EPDM vulcanised ductile cast iron.		
	Valve stems shall be stainless steel 420.		
	Stem nuts shall be of bronze or dezincification resistant brass		
	Seals and O-rings shall be of EPDM.		
	Internal and external fasteners shall be of stainless steel 304.		
	Dimensional drawings of all valves shall be submitted.		

***** ***Columns A and B to be completed by Public Entity.***

Specifications and Compliance Sheet Authorised By:

Name:		Signature:	
Position:		Date:	
Authorised for and on behalf of:		Company	

SECTION VI: GENERAL CONDITIONS OF CONTRACT AND CONTRACT AGREEMENT

Any resulting contract shall be placed by means of a Purchase Order/Letter of Acceptance and shall be subject to the General Conditions of Contract (GCC) for the Procurement of Goods - Ref. **G/RFQ-GCC** on the website of NamWater Ltd (www.namwater.com.na) except where modified by the Special Conditions below.

SECTION VI: CONTRACT AGREEMENT

Any resulting contract shall be placed by means of a Purchase Order/Letter of Acceptance and shall be subject to the General Conditions of Contract (GCC) for the Procurement of Goods except where modified by the Special Conditions below.

SECTION VIII: SPECIAL CONDITIONS OF CONTRACT

Procurement Ref No. G/RFQ/NW-039/2027

The clause numbers given in the first column correspond to the relevant clause numbers of the GCC.

Subject and GCC clause reference	Special Conditions
Purchaser **GCC 1.1(h)**	The purchaser is: **Namibia Water Corporation (NamWater)**
Site **GCC 1.1(m)**	The Site/destination for delivery of the Goods is the **NamWater Oshakati area office**
Incoterms Edition **GCC 4.2(b)**	Incoterms shall be governed by the rules prescribed in Incoterms 2010.
Notices **GCC 8.1**	Any notice shall be sent to the following addresses: For NamWater Ltd the address and the contact name shall be: Procurement Management Unit (Tel: +264 61 71 2081), E-mail: bids@namwater.com.na Private Bag 13389 Windhoek, Namibia For the Supplier, the address and contact name shall be: _____
Disputes **GCC 10.2**	The rules of procedures for arbitration proceedings pursuant to GCC 10.2 shall be as follows: In the case of a dispute between the Purchaser and a Supplier, the dispute shall be arbitrated in accordance with Arbitration Act, 1965 (Act No. 42 of 1965).

Subject and GCC clause reference	Special Conditions
Delivery and Documents **GCC 13.1**	The Goods are to be delivered within **60 days** from the date of the Purchase Order or the Letter of Acceptance. The documents to be furnished by the Supplier are: (a) signed delivery note; (b) Invoice
Price Adjustment **GCC 15.1**	The price charge for the Goods supplied and the related Services performed **shall not** be adjustable. If the prices are adjustable, the method described in the Price Adjustment Formula as attachment to these SCC shall be used.
Terms of Payment **GCC 16.1**	The structure of payments shall be: full payment following delivery of the Supplies and submission of an invoice and the documents listed in clause 13.1
Terms of Payment **GCC 16.3**	Payments shall be made not later than thirty days after month of invoice upon submission of an invoice and its certification by the Purchaser.
Terms of Payment **GCC 16.4**	The currency of payment shall be the currency of order specified in the List of Goods, Price Schedule and Product details in the Statement of Requirements
Performance Security **GCC 18.1**	(i) No performance security is required
Performance Security **GCC 18.4**	Not applicable
Packing **GCC 23.2**	The packing, marking and documentation within and outside the packages shall be: as per the manufacturer's branding and labeled: **G/RFQ/NW-039/2027** **Supply and Delivery of Hot-Dipped Galvanised Steel Pipe Fittings, Flange Adaptors and Gate Valves for the Oshakati Temporary Evaporation Ponds.** **NamWater** **Oshakati**
Insurance **GCC 24.1**	The insurance should be covered as described in **Delivery Duty Paid (DDP)**
Transportation **GCC 25**	The Goods shall be delivered: **Delivery Duty Paid (DDP)**
Inspection and Test **GCC 26.1**	NamWater will inspect all items upon delivery to ascertain Technical compliance and specification compliance verification.

Subject and GCC clause reference	Special Conditions
Location of Inspection and Tests **GCC 26.2**	The inspections and tests shall be conducted at: **NamWater Oshakati area office**
Liquidated Damages **GCC 27**	Liquidated damages for the whole contract are 1/14% per day. The maximum amount of liquidated damages for the whole contract is 14% of the final contract price.
Warranty **GCC 28.3**	The period of validity of the warranty shall be: 12 Months
Repair and Replacement **GCC 28.5**	The period for repair or replacement shall be: **8 weeks**

SCHEDULE 3
QUOTATION CHECKLIST SCHEDULE


Procurement Reference No.: G/RFQ/NW-039/2027

Description	Attached	Not Attached
Quotation Letter		
Priced Activity Schedule		
Specification and Compliance Sheet		
Signed Bid Securing Declaration		
Evidence for conformity of Goods		
Valid copy of company registration/founding statement. **(certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)**		
Original valid good standing Tax Certificate from **Inland Revenue** or a valid certified copy of an original certified by **a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963**		
Original valid good Standing Certificate from the **Social Security Commission or** a valid certified copy of an original **(certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)**		
A certified copy of a valid Affirmative Action Compliance Certificate, or proof from Employment Equity Commissioner that bidder is not a relevant employer, or exemption issued in terms of Section 42 of the Affirmative Action Act, 1998; **(certified by a Commissioner of Oath appointed in terms of the Justices of the Peace and Commissioners of Oaths Act.1963 (Act No. 16 of 1963)**		
An undertaking on the part of the Bidder that the salaries and wages payable to its personnel in respect of this proposal are compliant to the relevant laws, Remuneration Order, and Award, where applicable and that it will abide to sub-clause 4.6 of the General conditions of Contract if it is awarded the contract or part thereof; and		

Supply Product catalogues and any other literature to substantiate compliance, where applicable. These documents must be from the manufacturer or an authorized manufacturer's representative. Representatives must provide an authorised letter from the manufacturer confirming their status.		

Disclaimer: *The list defined above is meant to assist the Bidder in submitting the relevant documents and shall not be a ground for the bidder to justify its non-submission of major documents for its quotation to be responsive. The onus remains on the Bidder to ascertain that it has submitted all the documents that have been requested and are needed for its submission to be complete and responsive.*

15/4/1/7/6 – 354R0

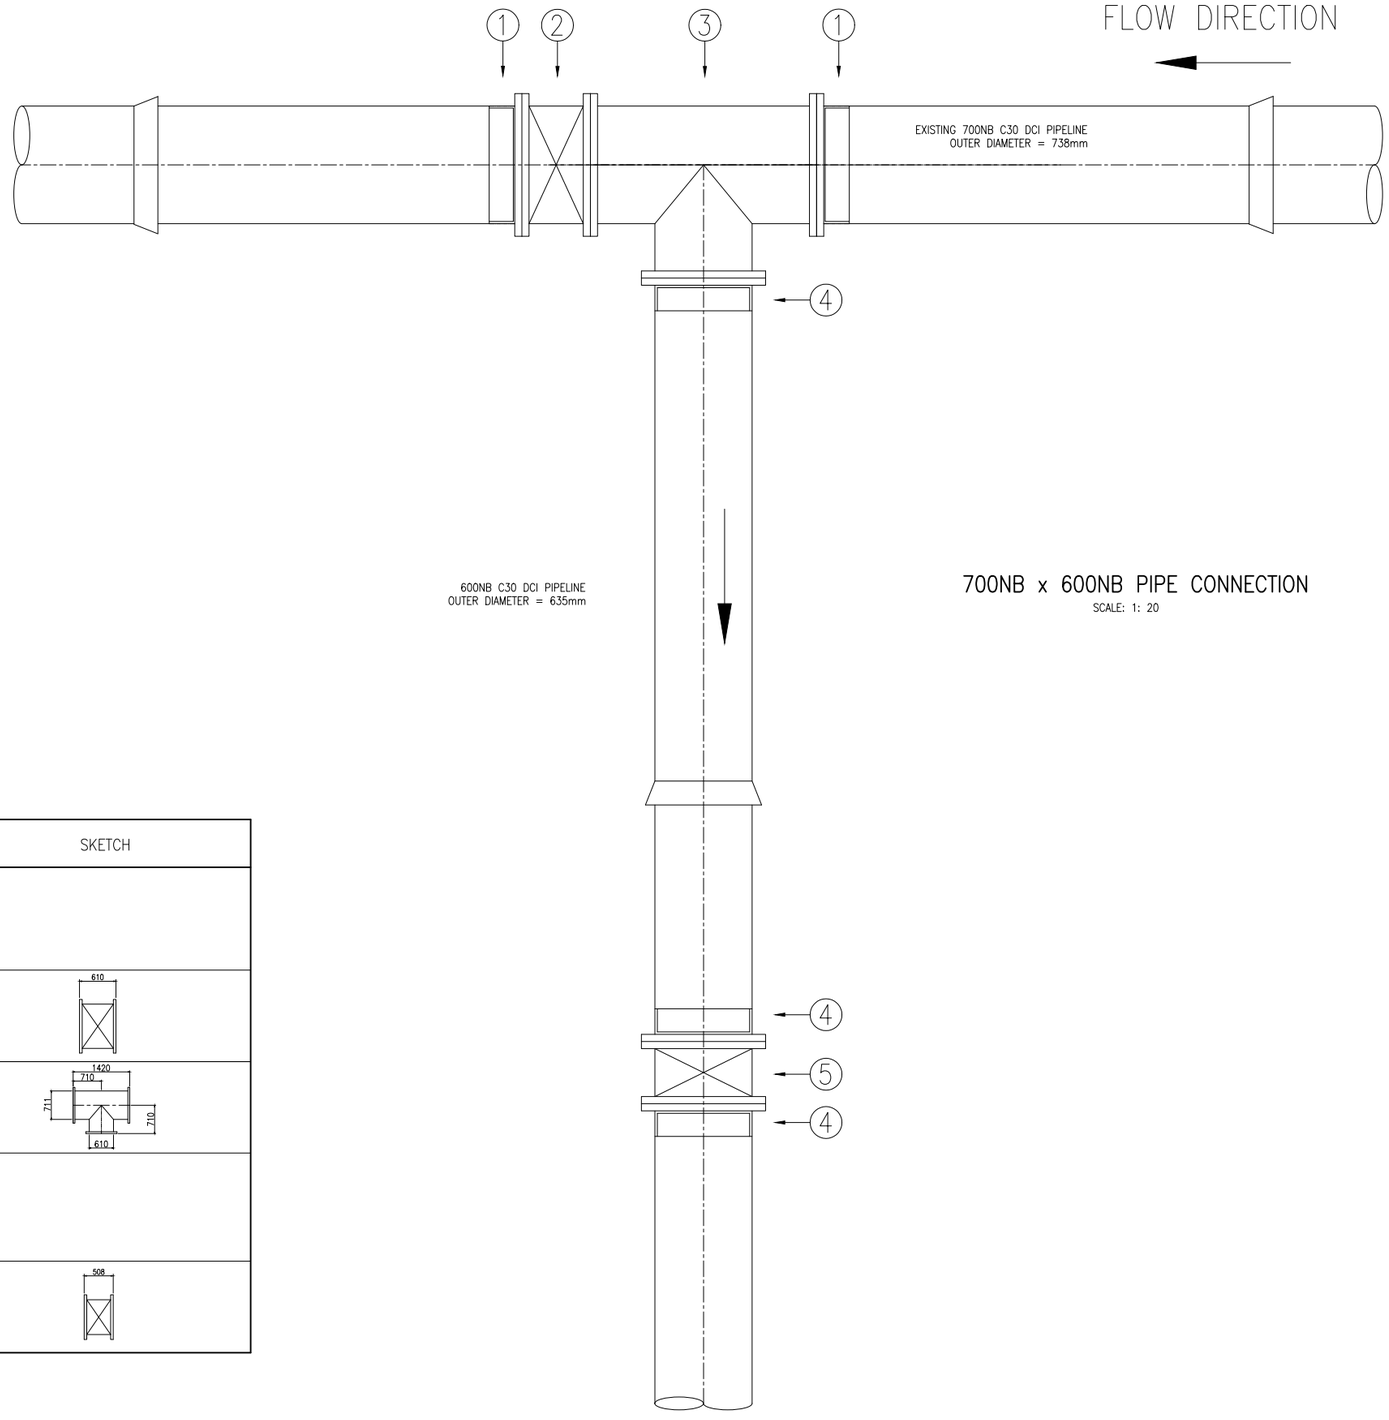

700NB x 600NB PIPE CONNECTION

SCALE: 1: 20

PIPE SCHEDULE

ITEM NO.	SIZE DN	NO. OFF	DESCRIPTION	SKETCH
1	700	2	700NB FLANGE ADAPTOR TO FIT 700NB DCI PIPE WITH OD OF 738mm. FLANGED AND DRILLED TO SABS 1123, TABLE 1000/3. **CORROSION PROTECTION: HOT DIPPED GALVANIZED**	
2	700	1	700NB, PN10, RESILIENT SEAT GATE VALVE, NON-RISING SPINDLE. FLANGED AND DRILLED TO SABS 1123, TABLE 1000/3. FACE-TO-FACE DIMENSION = 610mm. **CORROSION PROTECTION: HOT DIPPED GALVANIZED**	
3	700 X 600	1	700NB X 600NB SPECIAL REDUCING T-PIECE AS DETAILED. BOTH ENDS FLANGED AND DRILLED TO SABS 1123, TABLE 1000/3. **CORROSION PROTECTION: HOT DIPPED GALVANIZED**	
4	600	3	600NB FLANGE ADAPTOR TO FIT 600NB DCI PIPE WITH OD OF 635mm. FLANGED AND DRILLED TO SABS 1123, TABLE 1000/3. **CORROSION PROTECTION: HOT DIPPED GALVANIZED**	
5	600	1	600NB, PN10, RESILIENT SEAT GATE VALVE, NON-RISING SPINDLE. FLANGED AND DRILLED TO SABS 1123, TABLE 1000/3. FACE-TO-FACE DIMENSION = 508mm. **CORROSION PROTECTION: HOT DIPPED GALVANIZED**	

NOTES :

1. ALL FLANGES TO BE DRILLED TO SABS 1123, TABLE 1000/3.
2. MILD STEEL ITEMS SHALL BE MANUFACTURED FROM MED. GAUGE STEEL TO SABS 062 OR TO SABS 719.
3. WHERE SPECIFIED, ALL ITEMS MUST BE HOT-DIP GALVANIZED TO SABS 763.
4. ALL CONCRETE WORKS TO BE 25 MPa /19 mm WITH AT LEAST 50 mm COVER.
5. ALL THRUST BLOCKS TO BE CAST AGAINST UNDISTURBED SOIL.
6. ALL BOLTS NUTS & WASHERS TO BE GRADE 4.8 HDG TO SABS 763.

NO.	AMENDMENTS	DATE	BY
0	FOR TENDER PURPOSES ONLY	10/2026	GB

NAMWATER
Namibia Water Corporation Ltd

SCHEME
OSHAKATI – ONDANGWA WATER SUPPLY SCHEME

DRAWING
OSHAKATI TEMPORARY EVAPORATION PONDS
700NB X 600NB PIPE FITTING DETAIL

SURVEYED	DRAWN	TRACED
	G. BENADE	AUTOCAD
DESIGNED CIVIL	DESIGNED ELEC.	DESIGNED MECH.
I. EKANDJO		
CHECKED CIVIL	CHECKED ELEC.	CHECKED MECH.
APPROVED CIVIL	APPROVED ELEC.	APPROVED MECH.

GENERAL MANAGER ENGINEERING AND SCIENTIFIC SERVICES

DATE	SCALE	SHEET NO.
10/2026	AS SHOWN	1 OF 1

REGISTRATION NO.
15/4/1/7/6 – 354R0